


This drawing is supplied for reference only. It is subject to review and approval by the Project Architect and/or other members of the Design Team.

DISCLAIMER:
All dimensions & facilities to be verified on site.

NOTES:
Drawn in Acad 2000 saved as a Acad 14 file. Model space drawing scale 1:1. Paper space NTS.

- KEY:**
- 1 = 125A 3 Phase Marelchal with Breaker in DB - Psevr 1
 - 2 = 125A 3 Phase Marelchal with Breaker in DB - Psevr 2
 - 3 = 125A 3 Phase Marelchal with Breaker in DB - Psevr 3
 - 4 = 125A 3 Phase Marelchal with Breaker in DB - Psevr 4
 - 5 = 125A 3 Phase Marelchal with Breaker in DB - Psevr 5
 - 6 = 125A 3 Phase Marelchal with Breaker in DB - Psevr 6
 - 7 = 63A 3 Phase Terminal with Breaker in DB - PF 5

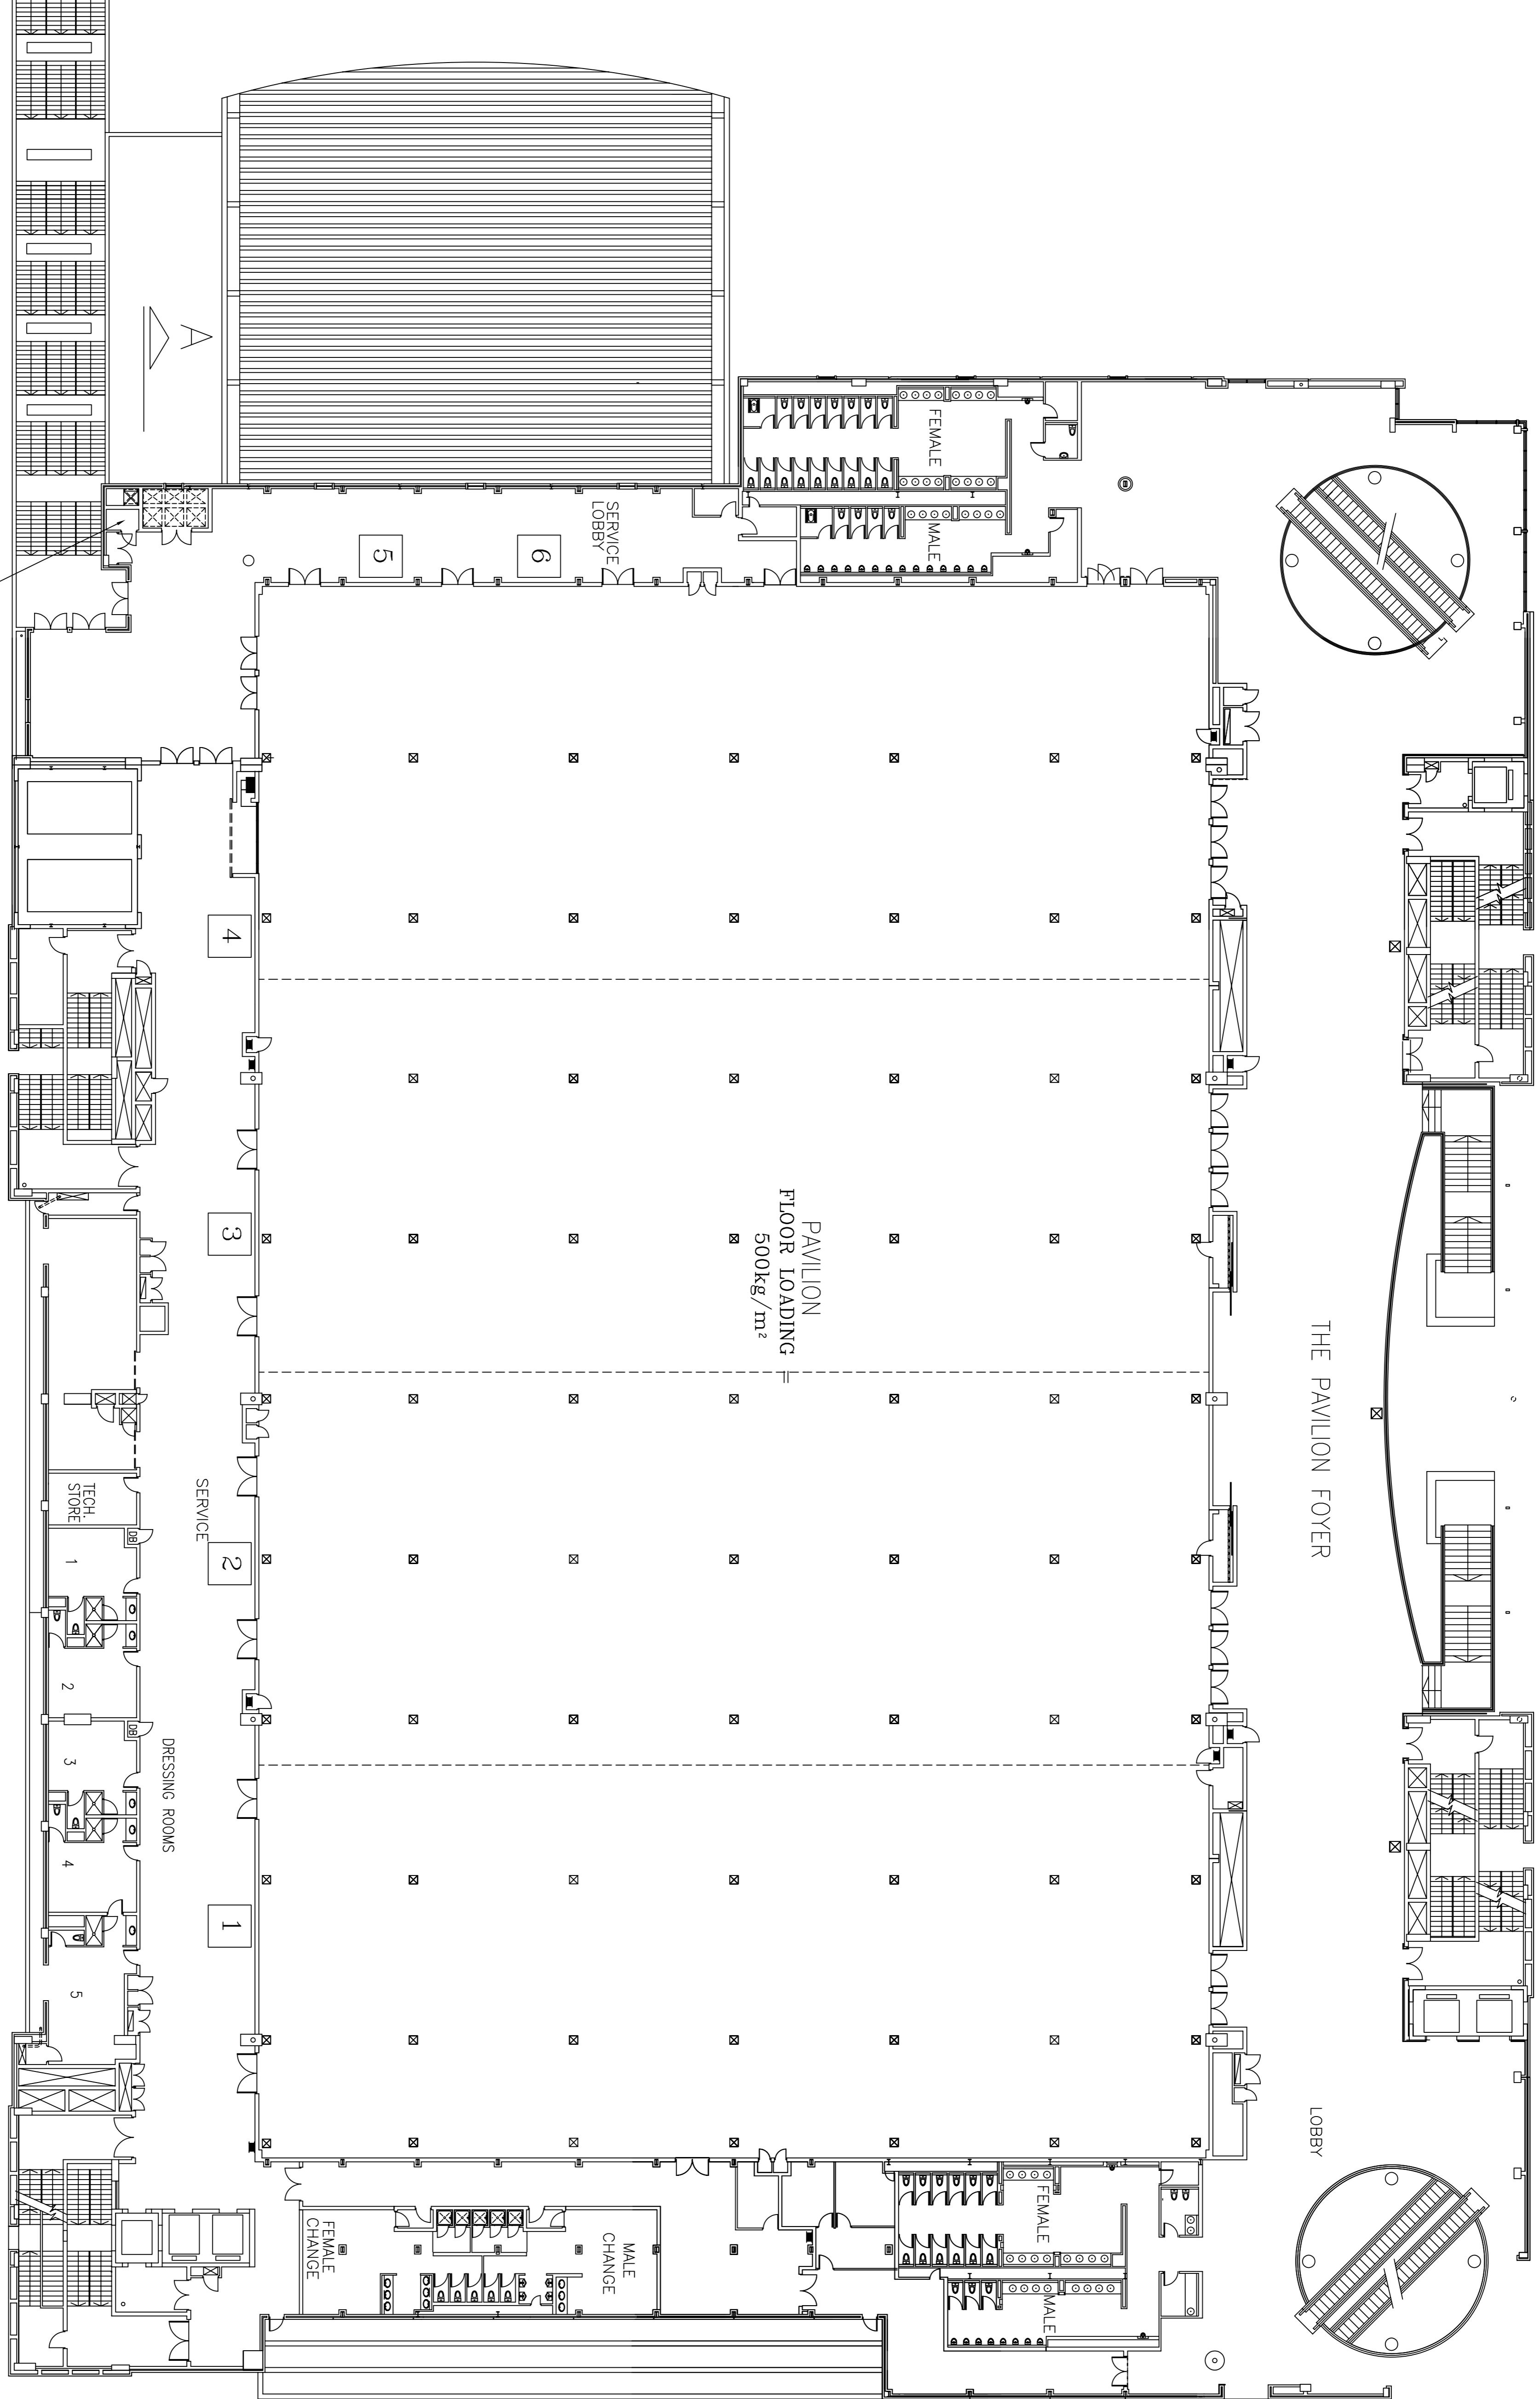

Project: SANDTON CONVENTION CENTRE	
Title: LEVEL 5 PAVILION	
Date: 5/7/01	Revision: -
Dwg: SCC-006	Scale: NTS